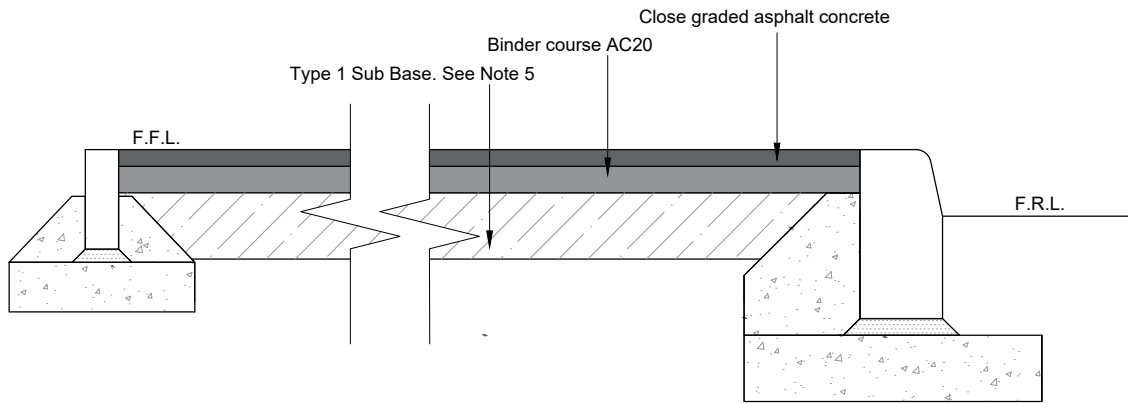
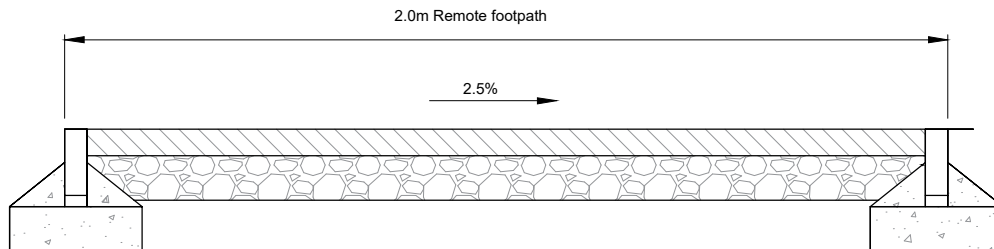




OPTION 1: FOOTWAY/FOOTPATH/CYCLE TRACK DETAIL. URBAN LOCATIONS



OPTION 2: FOOTWAY/FOOTPATH/CYCLE TRACK DETAIL. URBAN LOCATIONS



REMOTE FOOTPATH DETAIL

-  40mm thick Close graded asphalt concrete surface course - AC10 to CI 912 SHW.
-  100mm Granular sub-base material Type 1 to CI 803 SHW

Footway/Footpath/Cycle Track Construction

Type	Sub-base	Binder Course	Surface Course
Urban locations			
Flexible Construction	100mm Type 1 to SHW CI 803	50mm thickness AC20 binder course to SHW CI 906	OPTION 1: 40mm Hot Rolled Asphalt 30/14 to SHW CI 911
			OPTION 2: 30mm thickness AC 10mm aggregate close graded asphalt concrete surface course to SHW CI 912 or 40mm thickness AC 14mm aggregate close graded asphalt concrete surface course to SHW CI 912
Small Element Slabs (Pedestrian areas only)	150mm Type 1 to SHW CI 803	25mm bed medium coarse sand to BS 7533 Part 4 and SHW Clause 1104 (5)	OPTION 3: 400x400x60mm slabs to SHW CI 1104
Block Paving Construction (Pedestrian areas only)	150mm Type 1 to SHW CI 803	50mm thick sharp sand to BS 7533 Part 3 Annex D	OPTION 4: 200x100x80mm thick rectangular block paving to SHW CI 1107
Other	Other types, such as granolithic concrete, setts and natural stone slabs, are only suitable where specified by planning requirements, with construction make-up to be agreed.		
Rural locations			
Flexible construction for footways, footpaths and cycle tracks	200mm Type 1 material to SHW CI 803	50mm thickness AC20 binder course to SHW CI 906	OPTION 5: 30mm thickness AC 10mm aggregate close graded asphalt concrete surface course to SHW CI 912 or 40mm thickness AC 14mm aggregate close graded asphalt concrete surface course to SHW CI 912
			OPTION 6: Single course 50mm thickness AC 14mm aggregate close graded asphalt concrete Surface Course to SHW CI 912

Notes

1. All dimensions in millimeters.
2. The specification referred to in this drawing is the *Specification for Highway Works* (SHW) published by T.S.O. (The Stationery Office).
3. This drawing is to be read in conjunction with drawing SD/1100/05.
4. For details of kerbs and kerb foundations refer to drawing SD/1100/01.
5. The sub-base shall be increased to 200mm for drive footway crossings. For further detail, refer to Drawing SD/1100/07.
6. For footways on bridge decks consult Structures Team.

Revision Details	Drawn by	Checked by	Check Date	Surf



Project: Standard details. Series 1100:
 Kerbs, footways, cycleways and paved areas

Title: Footway, footpath, cycletrack construction: Sheet 1

Scale (at A4): Not to scale

Drawn: JC Date: 09/2023

Checked: CHK Date: 09/2023

Drawing No: SD/1100/04 Rev: 1